

CBCS SCHEME

15EE71

USN						
-----	--	--	--	--	--	--

Seventh Semester B.E. Degree Examination, July/August 2022 Power System Analysis - II

Time: 3 hrs.

Max. Marks: 80

Note: Answer any FIVE full questions, choosing ONE full question from each module.

Module-1

- 1 a. With usual notations, prove that $Y_{BUS} = A^T [Y] A$ using singular transformation. (06 Marks)
- b. For the data given in table Q1(b), obtain Y_{BUS} using singular transformation.

Element No	From Bus	To Bus	Self Impedance (pa)	Mutual Impedance (pu)
1	0	1	- 0.2 j	-
2	1	2	0.05 j	-
3	2	3	0.04 j	0.2 j (with 2)
4	3	1	0.02 j	-


Table : Q1(b)

(10 Marks)

OR

- 2 a. For the 3 – bus system shown in Fig. Q2(a), estimate the voltages at bus 2 and bus 3 at the end of first iteration using G.S method. The values of data required for load flow is listed in table Q2(a). The reactive power limits at bus 2 is $- 0.5 \leq Q_2 \leq 0.5$ p.u. (10 Marks)

Fig. Q2(a)

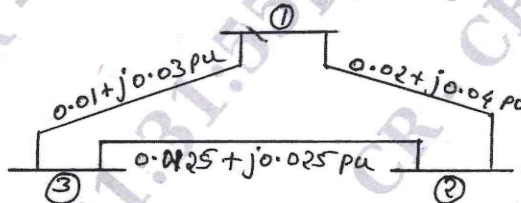

Bus No	P_i (pu)	Q_i (pu)	$ V_i $ (pu)	δ_i	Type
1	-	-	1.05	0	Slack
2	0.3	-	1.02	-	PV
3	-1.4	-0.5	-	-	PQ

Table : Q2(a)

- b. Explain how buses are classified to carry out load flow analysis in power system. (06 Marks)

Module-2

- 3 a. With all assumption, deduce FDLF model and give flow chart. (10 Marks)
- b. Compare Gauss – Seidal and Newton – Raphson methods of load flow analysis. (06 Marks)

OR

- 4 a. Derive expression for all elements of Jacobian matrices on Polar form. (10 Marks)
- b. Explain any two method of control of voltage profile. (06 Marks)

Module-3

- 5 a. With a usual notation, derive generalized transmission loss formula and B – Coefficients. (10 Marks)

CMRIT LIBRARY
BANGALORE - 560 037

Important Note : 1. On completing your answers, compulsorily draw diagonal cross lines on the remaining blank pages.
2. Any revealing of identification, appeal to evaluator and /or equations written eg, 42+8 = 50, will be treated as malpractice.

- b. The operating cost of C_1 and C_2 in Rs/hr of two generator units each of 100MW rating of a thermal plant are : $C_1 = 0.2 P_1^2 + 40 P_1 + 120$ Rs/hr ; $C_2 = 0.25 P_2^2 + 30 P_2 + 150$ Rs/hr
- Find optimal generation of 2 units for a total demand of 180 MW and corresponding total cost.
 - Savings in Rs/hr in the case, as compare to equal sharing between two machines.

(06 Marks)

OR

- 6 a. Calculate the loss coefficient in pu and MW^{-1} on a base of 50 MVA for the network shown in Fig. Q6(a) below :


$$I_a = 1.2 - j0.4, \quad I_b = 0.4 - j0.2, \quad I_c = 0.8 - j0.1, \quad I_d = 0.8 - j0.2, \quad I_e = 1.2 - j0.3,$$

$$Z_a = 0.02 + j0.08, \quad Z_b = 0.08 + j0.32, \quad Z_c = 0.02 + j0.08, \quad Z_d = 0.03 + j0.12,$$

$$Z_e = 0.03 + j0.12, \quad V_{ref} = 1 \angle 0.$$

(10 Marks)

Fig. Q6(a).

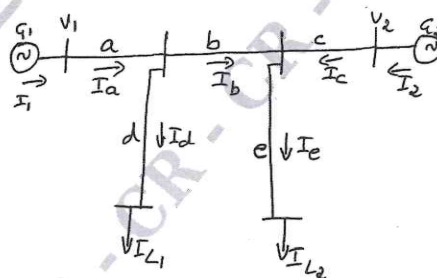

- b. Explain the following :

- Input – Output curve
- Heat rate curve related to thermal plants.

(06 Marks)

Module-4

- With the block diagram, explain system static level classification. (08 Marks)
- Discuss the solution procedure of optimal scheduling of Hydrothermal plants. (08 Marks)

OR

- Explain the following :
 - Loss of Load Probability (LOLP).
 - Frequency and duration of state (FAD).
- With the help of bath tub curve, explain Power System Reliability. (04 Marks)
- With the help of flow chart, explain Optimal load flow solution. (08 Marks)


Module-5

- Explain Solution of Swing equation by Point by Point method. (08 Marks)
- Derive the generalized algorithm for finding the elements of bus – impedance matrix Z_{bus} when a branch is added to the partial network. (08 Marks)

OR

- 10 a. For the three – bus network shown in Fig. Q10(a), build Z_{bus} . (10 Marks)

Fig. Q10(a)

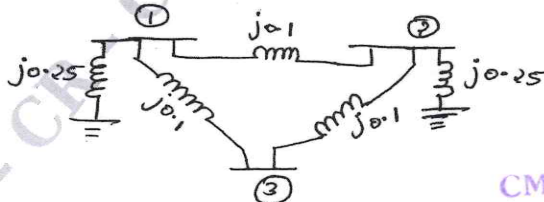

- b. Explain solution of swing equation by Range – Kutta 4th Order method. (06 Marks)
